

# C-800 LT Water Softening Resin Sodium Form

*Tested and certified to NSF/ANSI/CAN 61 and 372 and NSF/ANSI 44. for material safety only. Aldex C-800 LT is a high capacity, high quality, gel-type cation resin capable of meeting the most exacting requirements of household, farm, commercial, institutional and industrial water softeners. It is supplied in the sodium form as gold-colored translucent beads in 25-litre bags and larger bulk packages.*

## Physical Chemical Properties

Resin Composition:	Sulfonated styrene/ divinylbenzene copolymer
Ionic Form as Shipped:	Sodium (Na+)
Physical Form:	Golden color, translucent beads
Moisture Content:	45 to 49.9%
Total Capacity:	1.9 meq/ml minimum 41 kilograins as CaCO <sub>3</sub> per cubic foot
Odor and Taste:	None
Specific Gravity:	1.28
Net Weight (as shipped):	50 lbs per cubic foot
Particle Size:	315 to 1250 microns

## Recommended Operating Conditions

Influent pH:	No restrictions
Maximum Temperature:	250 °F
Bed Depth:	Minimum 24" Normal 36"
Service Flow Rate:	1 to 5 US GPM per cubic foot
Backwash Flow Rate:	See Fig. 2
Regenerant:	Sodium Chloride (NaCl) or Potassium Chloride (KCl)
Regenerant Strength:	5 to 15%, usually 10%
Regenerant Flow Rate:	0.3 to 1.0 US GPM per cubic foot of resin
Regenerant Contact Time:	15 to 60 minutes
Regenerant Dosage Level:	2 to 15 lb per cubic foot
Slow Rinse (Displacement) Flow Rate:	0.3 to 1.0 US GPM per cubic foot of resin
Slow Rinse Volume:	20 USG per cubic foot resin
Fast Rinse Rate:	1.0 to 5.0 US GPM per cubic foot resin
Fast Rinse Volume:	30 USG per cubic foot resin

## C-800 LT Features

### Very low color, taste or odor

Aldex C-800 LT meets the requirements for paragraph 173.25 of the Food Additive Regulation of the U.S. Food and Drug Administration.

### High Capacity

30,000 grains of softening capacity when regenerated with 15 lbs of NaCl per cubic foot and 20,000 grains with 6 lbs of NaCl per cubic foot ensuring high efficiency and low operating costs.

### Long Life

Strong and durable beads ensure long service life.

### Reliability

Aldex Chemical has over 40 years of field usage by thousands of customers demonstrate the reliability of Aldex ion exchange resins, zeolites and other water treatment media.

## Safety Information

A material safety data sheet is available for Aldex C-800 LT. Copies can be obtained from Aldex Chemical Co., LTD. Aldex C-800 LT is not a hazardous product and is not WHMIS controlled.

Caution: Acidic and basic regenerant solutions are corrosive and should be handled in a manner that will prevent eye and skin contact. Before using strong oxidizing agents in contact with ion exchange resin, consult sources knowledgeable in the handling of these materials.



Tested and certified to NSF/ANSI/CAN 61 and 372 and NSF/ANSI 44 for material safety only. See [www.wqa.org](http://www.wqa.org) for any restriction.



Since 1976

[aldexchemical.com](http://aldexchemical.com)

# C-800 LT Water Softening Resin Sodium Form

## C-800 LT Operating Suggestions


### Iron

Aldex C-800 LT will remove most of the dissolved iron, can filter much of the suspended iron and may or may not remove organically bound iron from water.\* When softeners are used to remove iron from the water, periodic cleaning of the bed mechanically or with a chemical iron cleaner may be necessary.

*\*The removal of iron was not evaluated in the WQA certification.*

### Chlorine

All cation exchange resins are affected by chlorine and suffer degradation and swelling. It is recommended that the chlorine in the water be maintained below 1.0 ppm when using Aldex C-800 LT.

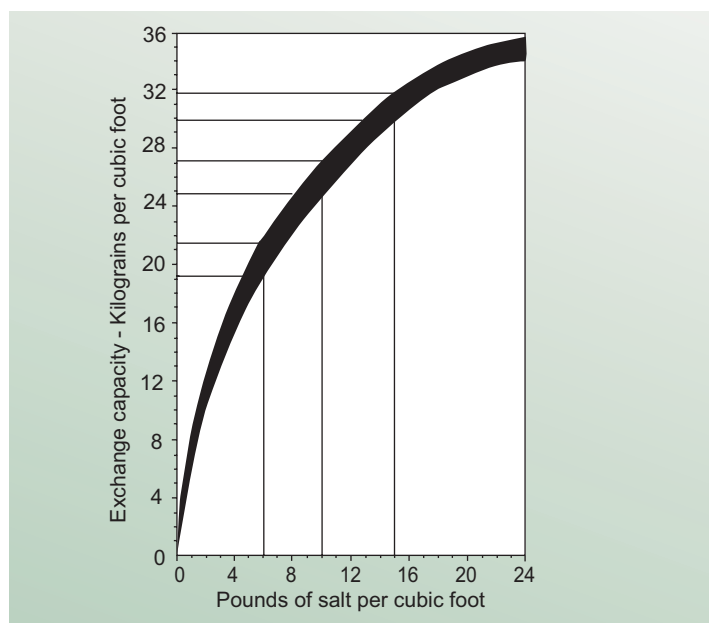


**Fig. 1** Exchange capacity vs. regeneration level Sodium form C-800 LT Cation Resin

## Backwash Characteristics

Aldex C-800 LT should be backwashed for at least 10 minutes after each service cycle in a conventionally down flow regenerated softener. To reclassify the beads and remove suspended solids from the top of the bed, the resin bed should be expanded at least 50% according to Fig. 2.

In the case of non-conventional or upflow regenerated softeners, it may not be necessary to follow the above procedure since the backwash and brine injection is incorporated in the same step.

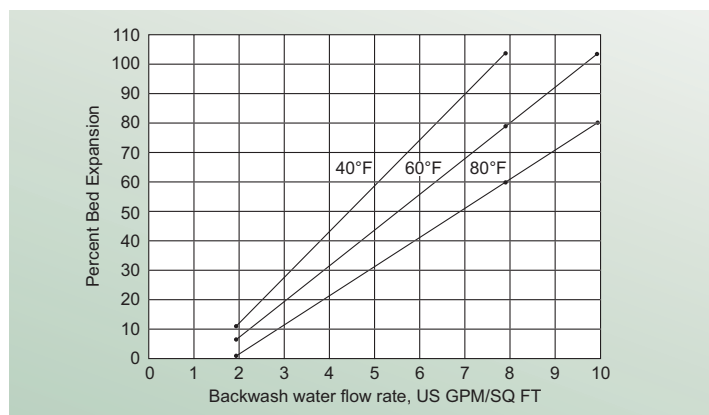

**Fig. 2** Bed expansion vs. backwash flow rate for various water temperatures



**Aldex Chemical Company, Ltd.** • 630 Laurent Street • Granby QC Canada J2G 8V1  
450 372 8844 • Fax 450 372 2566 • [info@aldexchemical.com](mailto:info@aldexchemical.com)

These suggestions and data are based on information we believe to be reliable. They are offered in good faith. However, we do not make any guarantee or warranty. We caution against using these products in an unsafe manner or in violation of any patents. Further, we assume no liability for the consequences of such actions.